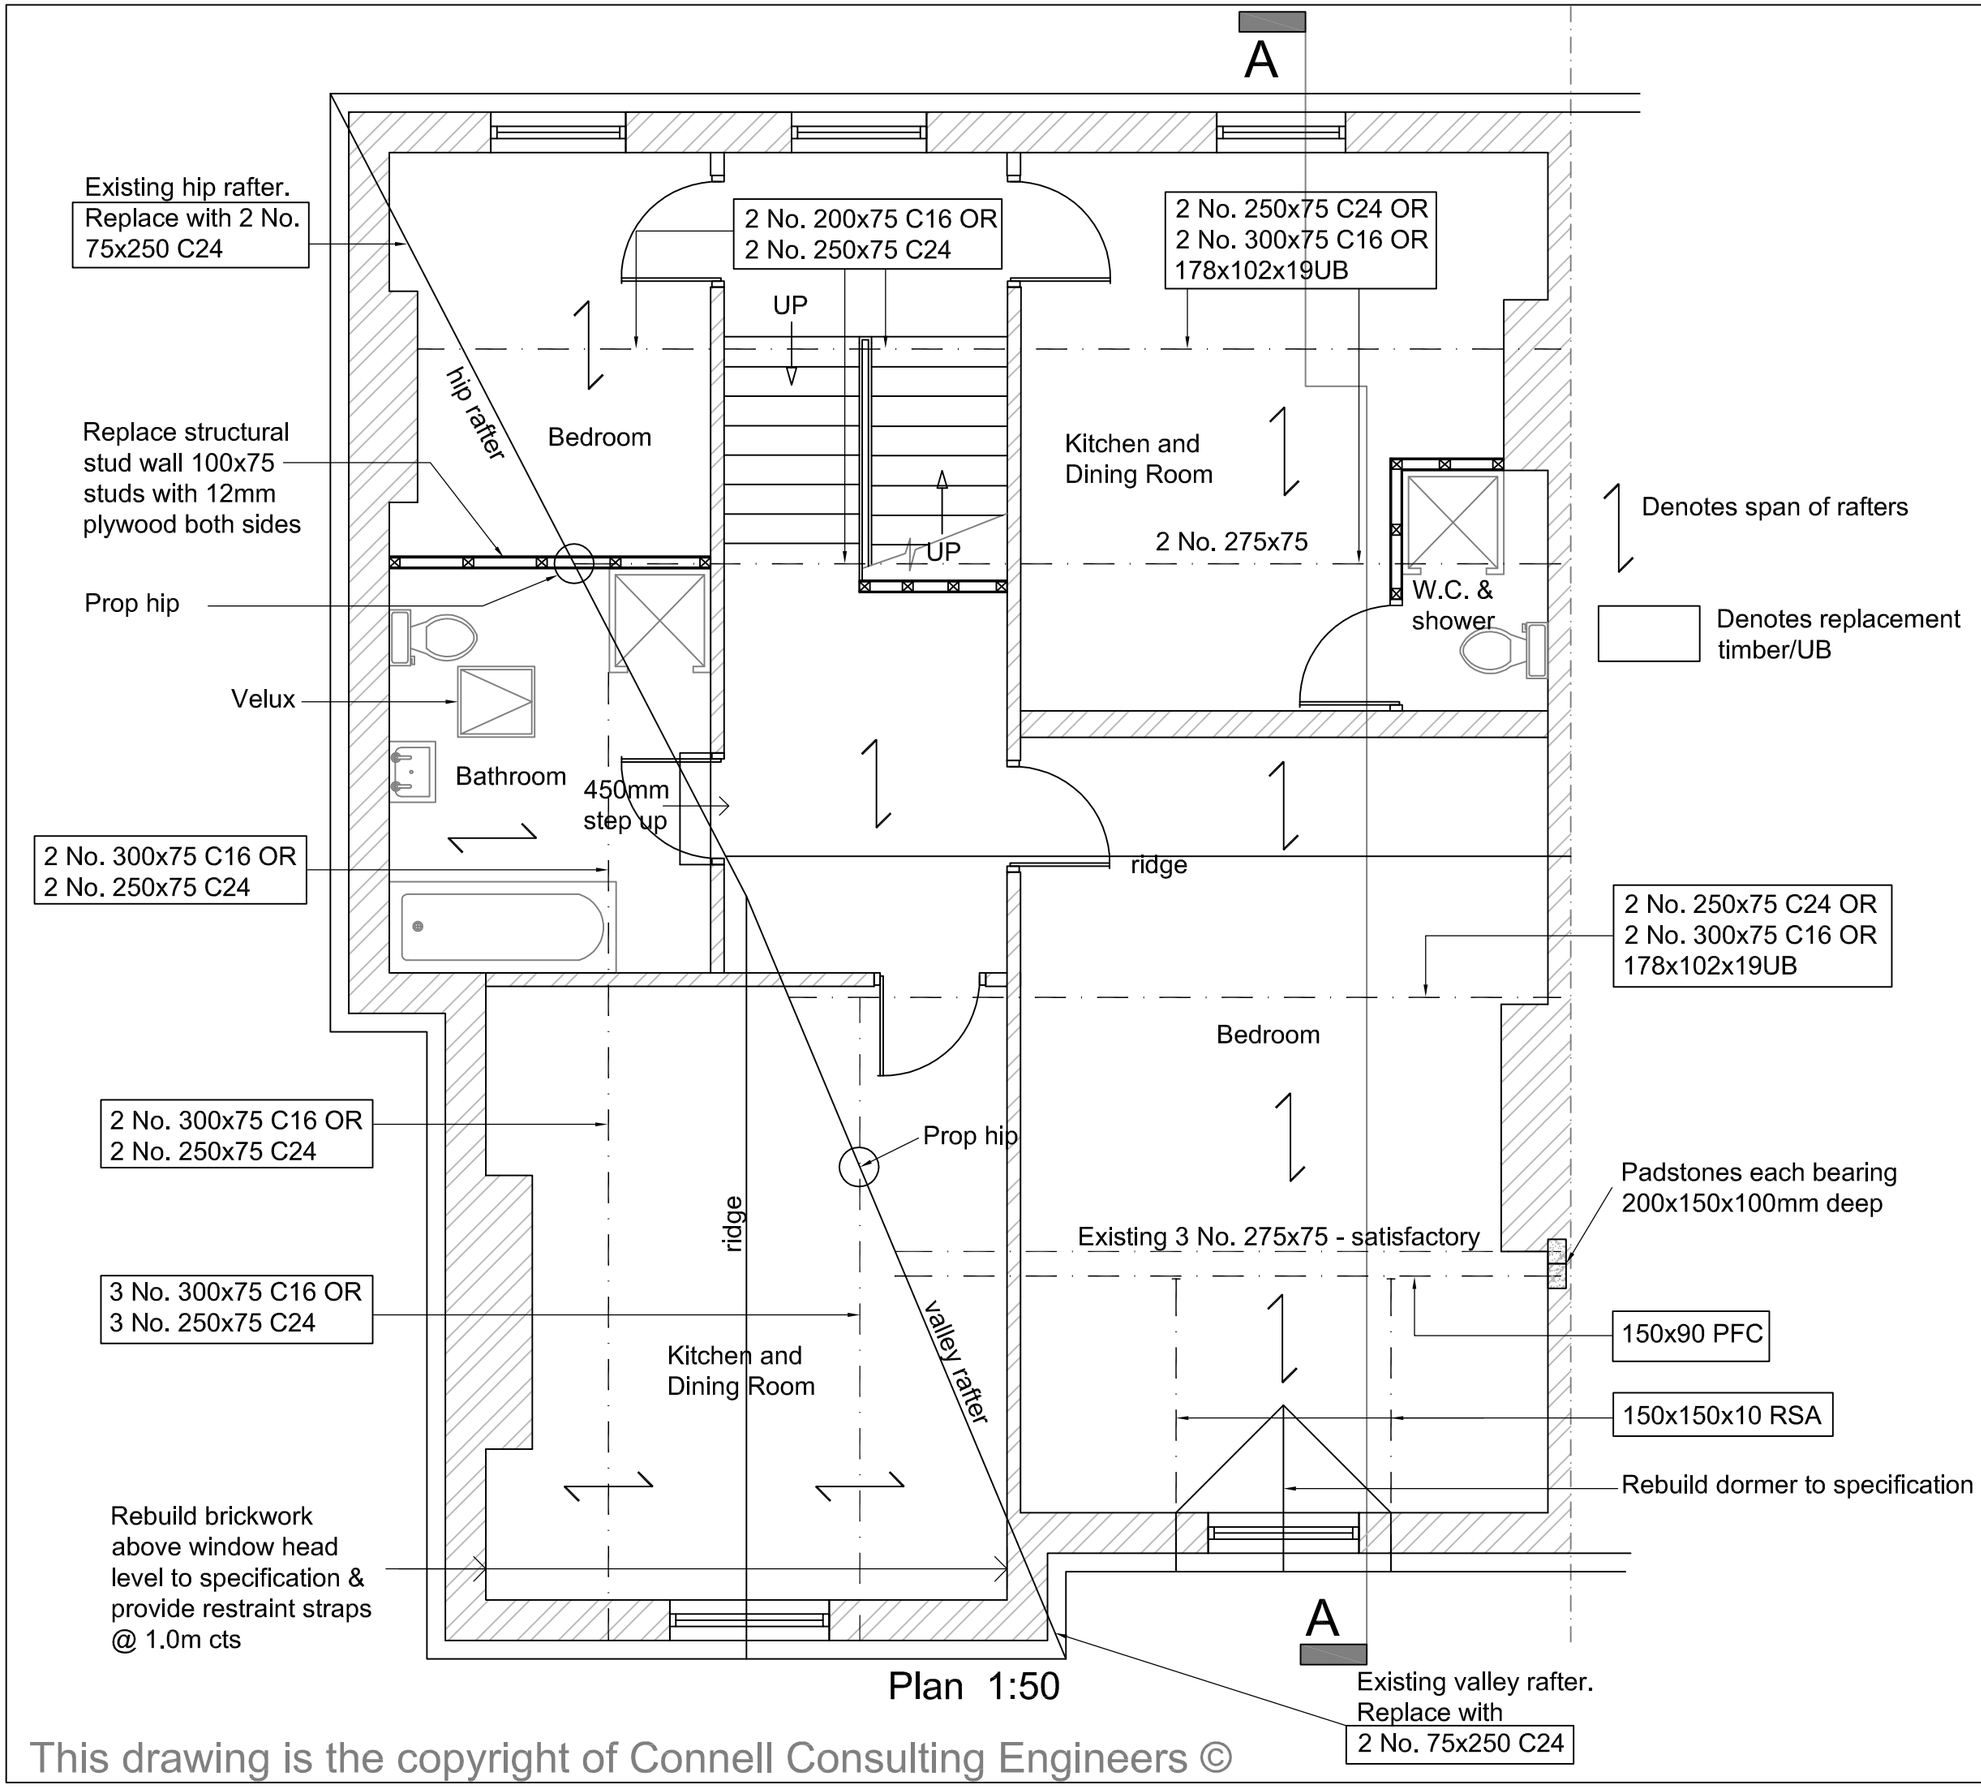

Plan 1:50

Notes

1. Do not scale this drawing. All dimensions to be verified on site.
2. All timber to be stress graded as stated.
3. If steel beams to be adopted, padstones at bearings are to be provided.
4. All rafters to be 50x125 C16 @ 400 cts.
5. All ceiling joists to be 50x125 C16 @ 400 cts.
6. Allow for new treated wall plates 75x100mm with galvanised straps at 1500 cts.

Rev	Information	date	by
B	Additional steel to dormer window	30/08/12	AP
A	Updated with latest information	17/08/12	AP

Connell
CONSULTING ENGINEERS
315 Old Chester Road, Birkenhead, CH42 3XQ
Tel: 0151 334 3606
Email: info@connellconsulting.co.uk

FOR APPROVAL

15 Denman Drive
Liverpool L6 7UF
Roof Replacement

Plan on Second Floor showing roof works

Job Number	Scale	Date	Drawn by	Rev
212230-01	1:50 @ A3	August 2012	A.P	B

This drawing is the copyright of Connell Consulting Engineers ©